



	Transformer		UG Open Elbows
	Fuse		UG Open Switches
	Recloser		Sectionalizer
	Electronic Recloser		Regulator
	Solid Bar Fuse		Switchgear
	Disconnect switch		

Overhead


Underground

Wire Equivalents

4 CU	2 CU	2/0 - > 477
4/0	ACSR	

Phasing

A	
B	
C	
2Ø	
3Ø	

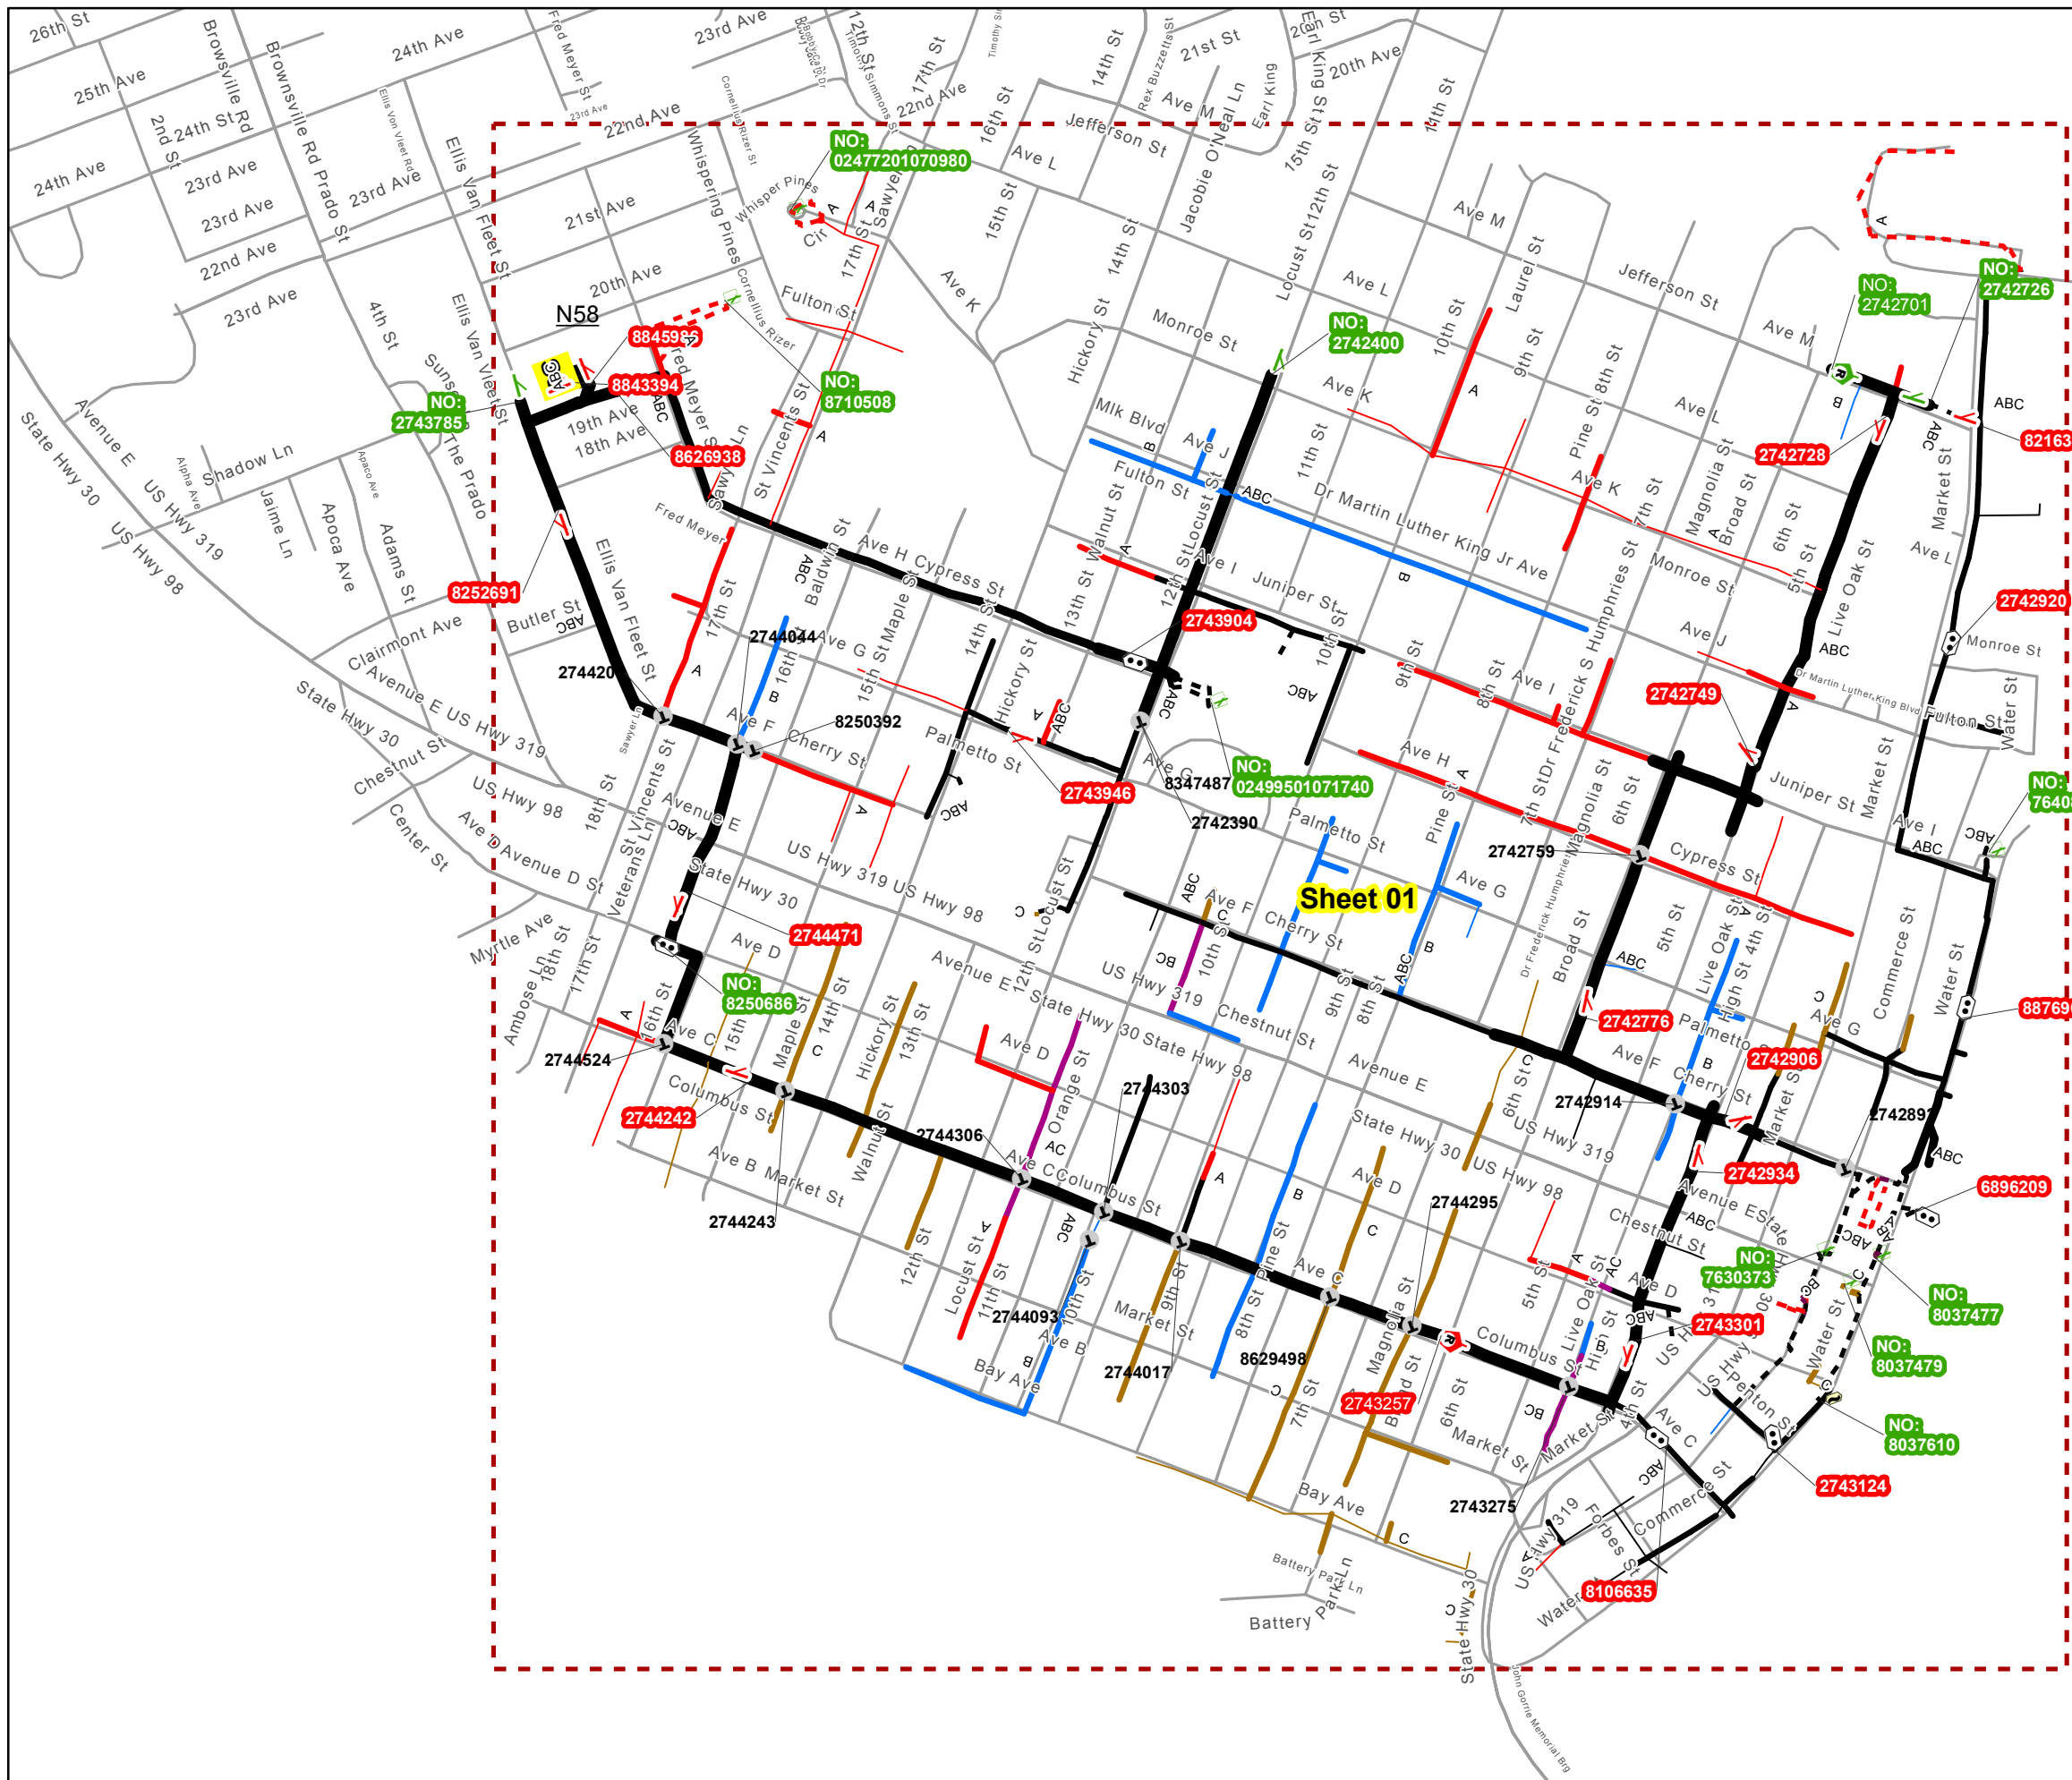




SH Team

Substation Lat/Long:

29.71928672  
-84.99918966



	Transformer		UG Open Elbows
	Fuse		UG Open Switches
	Recloser		Sectionalizer
	Electronic Recloser		Regulator
	Solid Bar Fuse		Switchgear
	Disconnect switch		TripSaver II

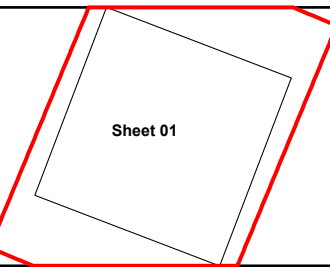

**Cardinal Electrical Safety Rules**  
Eradicate electrical contacts and flashes.

- \*Cover-Up/Insulate & Isolate
- \*Grounding/Zero Energy Check
- \*Electrical Safety PPE

